

# AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing  
A.B.N 43 006 014 106


1st Floor, 191 Racecourse Road, Flemington, Victoria 3031  
P.O Box 240, North Melbourne, Victoria 3051  
Phone (03) 9371 2400

## TEST REPORT

**Client :** Tarkett Australia Pty Ltd  
Suite 1 Level 3  
3 Columbia Court  
Baulkam Hills NSW 2153

**Test Number :** 24-003309  
**Issue Date :** 2/09/2024  
**Print Date :** 2/09/2024

**Sample Description** Clients Ref : "Somplan - 350"  
Vinyl sheet flooring  
Colour : Light Grey  
End Use : Flooring  
Nominal Composition : Compact Homogeneous Vinyl  
Nominal Mass per Unit Area/Density : 3300g/m2  
Nominal Thickness : 2mm

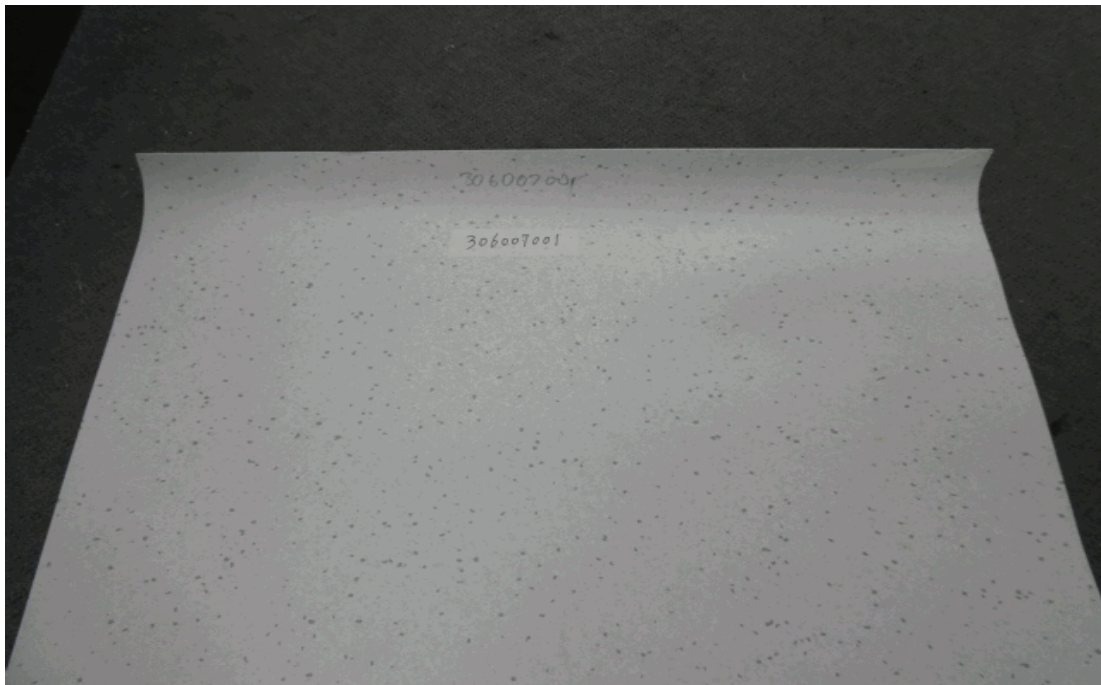

330045

72597

Page 1 of 2

© Australian Wool Testing Authority Ltd  
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025 - Testing  
Accreditation Numbers: 983, 985, and 1356

Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.



Fiona McDonald

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)  
MANAGING DIRECTOR

# AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing  
A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031  
P.O Box 240, North Melbourne, Victoria 3051  
Phone (03) 9371 2400

## TEST REPORT

**Client :** Tarkett Australia Pty Ltd  
Suite 1 Level 3  
3 Columbia Court  
Baulkham Hills NSW 2153

**Test Number :** 24-003309  
**Issue Date :** 2/09/2024  
**Print Date :** 2/09/2024

**AS 4586-2013  
Appendix A**

**Slip Resistance Classification of new Pedestrian Surface Materials  
Wet Pendulum Test Method**

Date of Testing 30-08-2024  
Operator AWTA Test Operator 4  
Test Temperature (20±5degC) 22 °C  
Sample washed with pH neutral detergent and dried  
Test Direction Length  
Fixed/Unfixed Unfixed

Slider No 96 Batch No 23

Length	1	2	3	4	5	SRV
British Pendulum number	49	48	48	50	49	49

Classification P4

Equipment: Cooper Pendulum Skid Tester Serial No: 1433-01 Calibrated 11/10/2023  
Slider prepared using P400 and 3µm lapping film.

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance and wear on their slip resistance be checked.

330045

72597

Page 2 of 2

© Australian Wool Testing Authority Ltd  
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025 - Testing  
Accreditation Numbers: 983, 985, and 1356

Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.



Fiona McDonald

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)  
MANAGING DIRECTOR